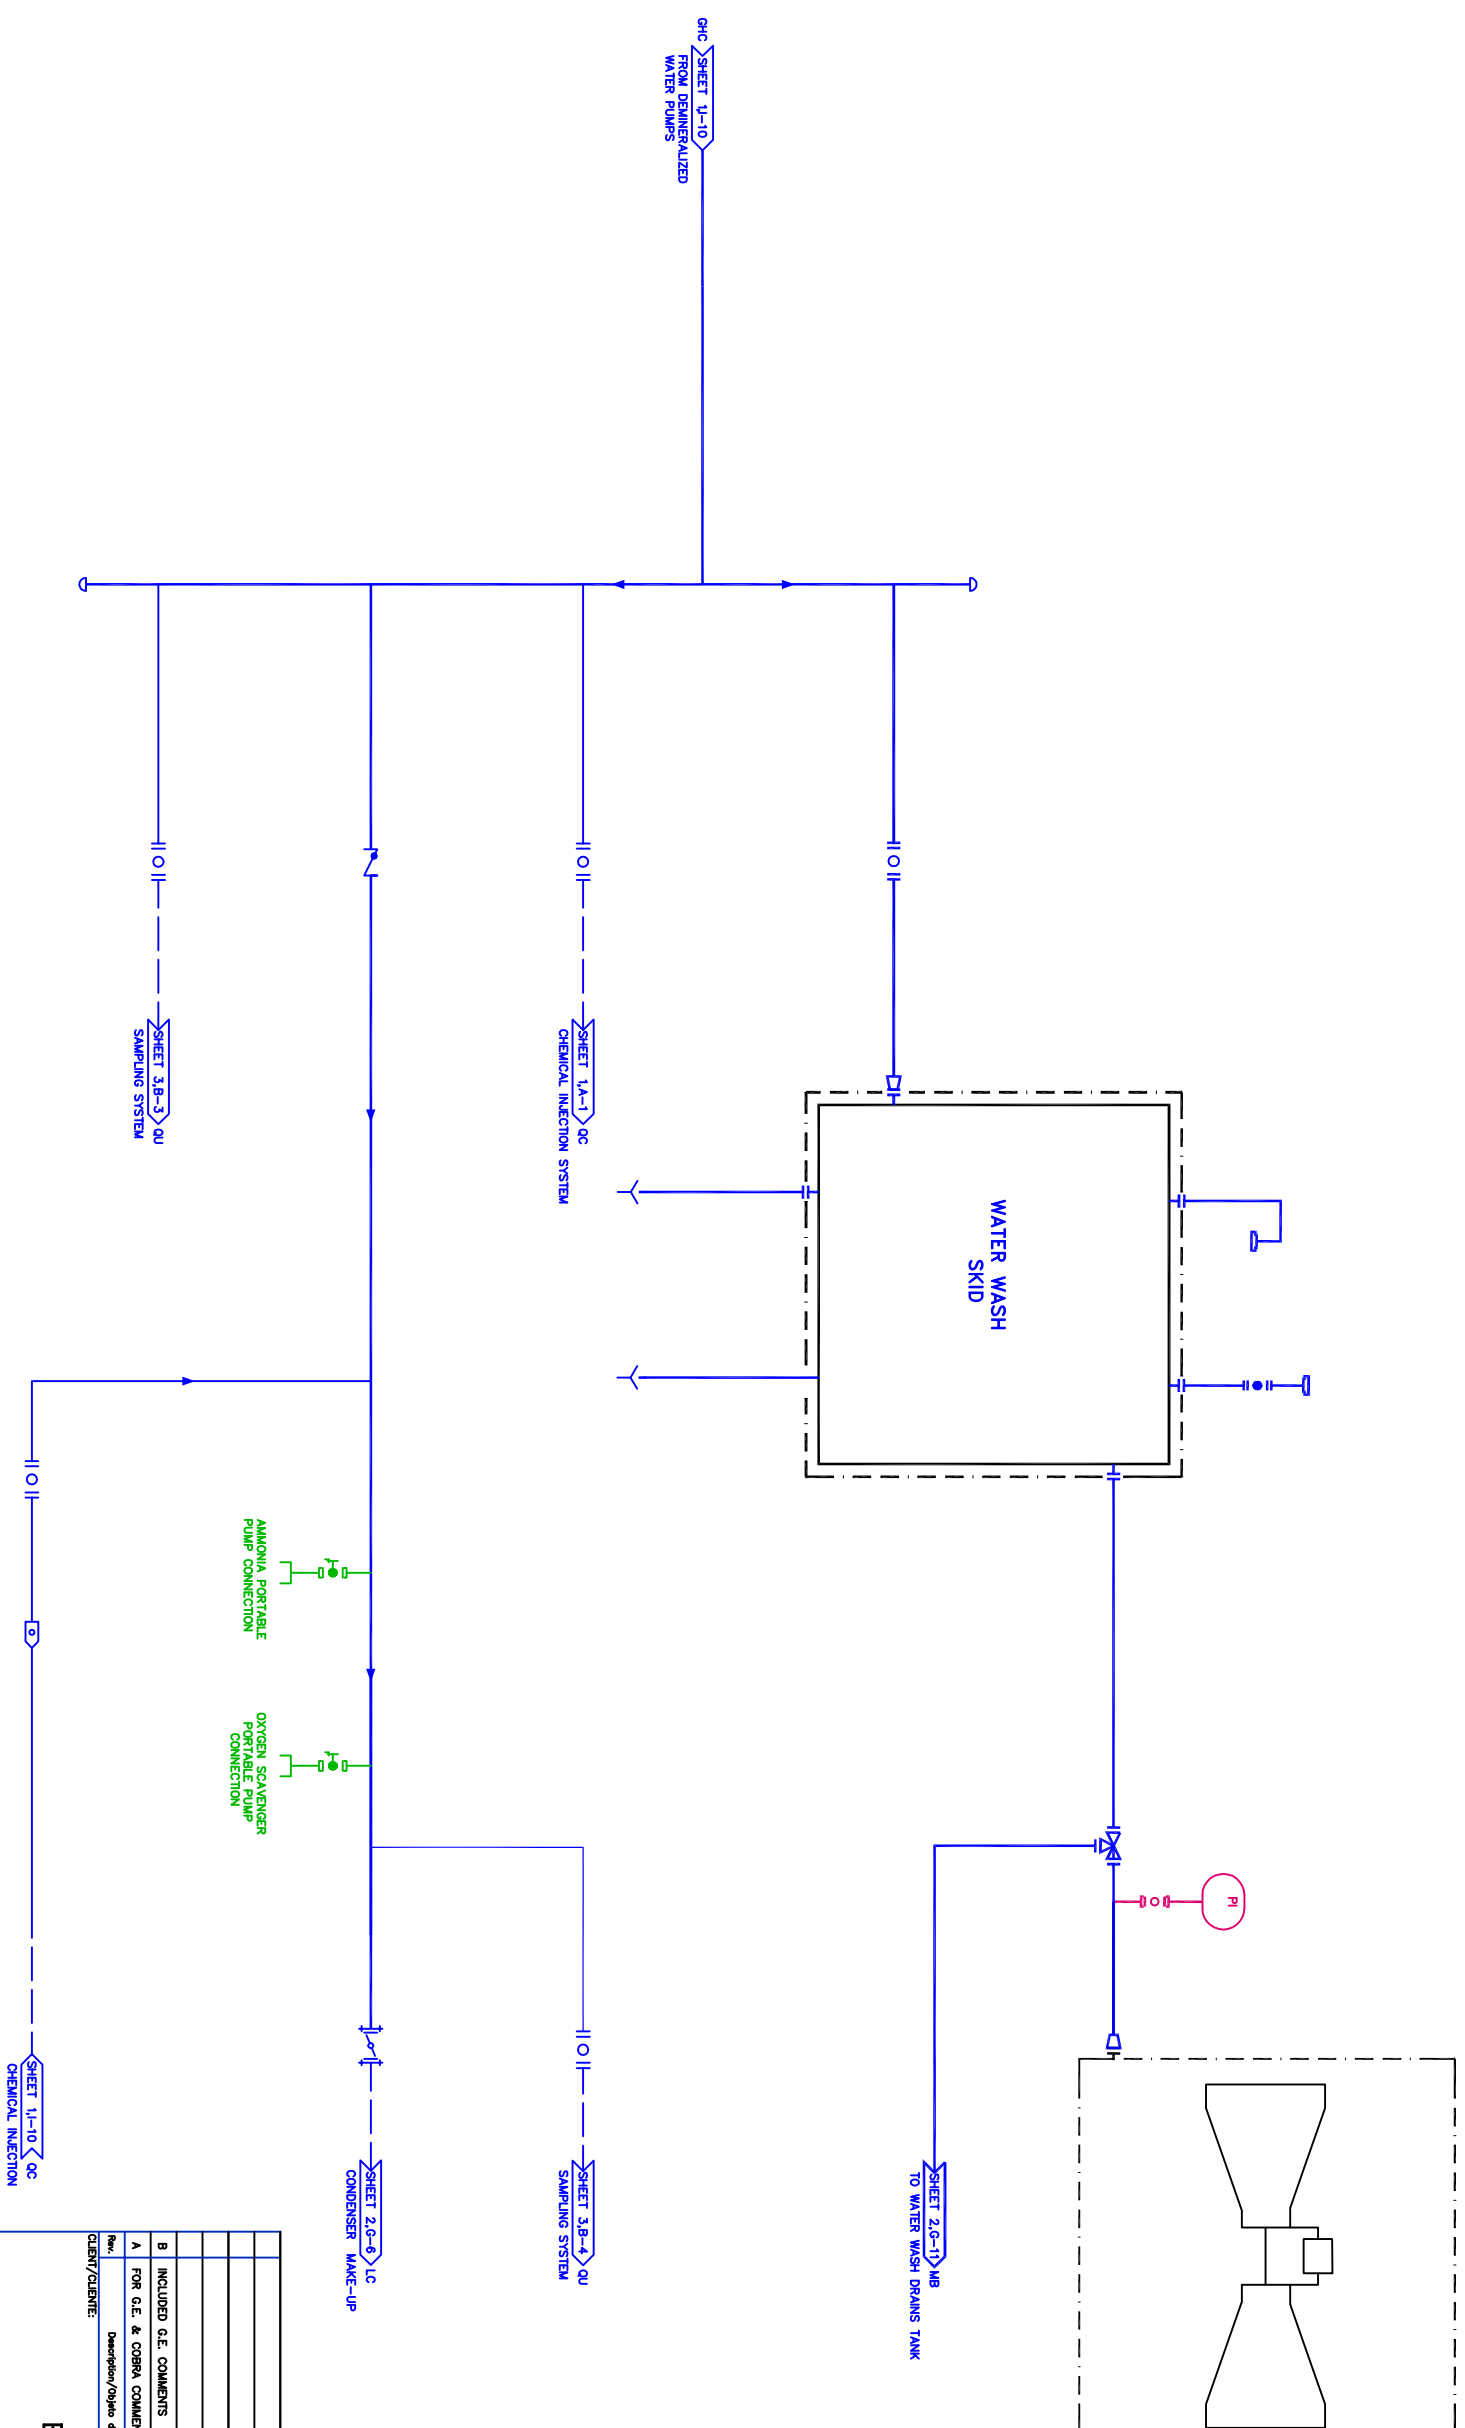


[illegible]

ENDESA FRANCE

MAIN CONTRACTOR

G.E.-COBRA-INTEC

DATE	JOB DESCRIPTION/PROJECT
11/1/2011	...
11/2/2011	...
11/3/2011	...
11/4/2011	...
11/5/2011	...
11/6/2011	...
11/7/2011	...
11/8/2011	...
11/9/2011	...
11/10/2011	...
11/11/2011	...
11/12/2011	...
11/13/2011	...
11/14/2011	...
11/15/2011	...
11/16/2011	...
11/17/2011	...
11/18/2011	...
11/19/2011	...
11/20/2011	...
11/21/2011	...
11/22/2011	...
11/23/2011	...
11/24/2011	...
11/25/2011	...
11/26/2011	...
11/27/2011	...
11/28/2011	...
11/29/2011	...
11/30/2011	...
12/1/2011	...
12/2/2011	...
12/3/2011	...
12/4/2011	...
12/5/2011	...
12/6/2011	...
12/7/2011	...
12/8/2011	...
12/9/2011	...
12/10/2011	...
12/11/2011	...
12/12/2011	...
12/13/2011	...
12/14/2011	...
12/15/2011	...
12/16/2011	...
12/17/2011	...
12/18/2011	...
12/19/2011	...
12/20/2011	...
12/21/2011	...
12/22/2011	...
12/23/2011	...
12/24/2011	...
12/25/2011	...
12/26/2011	...
12/27/2011	...
12/28/2011	...
12/29/2011	...
12/30/2011	...
12/31/2011	...

C.C. PP LACC

TITLE/TITULO: EVALUACIÓN DE LOS NIVELES DE CONOCIMIENTO DE LOS RIESGOS DE LA CONTAMINACIÓN DEL AGUA SUBTERRÁNEA EN LA ZONA DE LA SIERRA DE LA NEBLINA, MUNICIPIO DE LA CRUZ, GUAYAS, ECUADOR



VALID FOR BID ONLY
This drawing is prepared for conceptual design. The design may be changed during the detailed design stage.

DEMINERALIZED WATER SYSTEM P&ID											
Scale	Job number/ M328/10	Unit/ United	Serious/ Serious		Doc./Discipline	Doc. Orig./ Disc. Origin	Doc. n°	Serial Number or n° of origin	Free		
Size	Project/Projetos				Type/Type			Internal Serial n° of origin	Res.		
D6461	LAC	19	G	H	C	M	D	I	E M O O I	2	B