
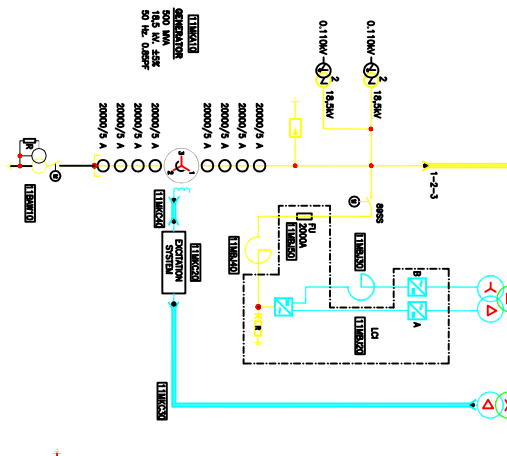
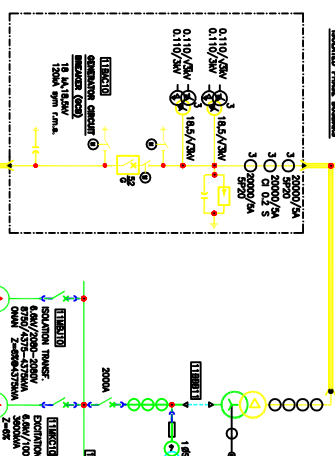


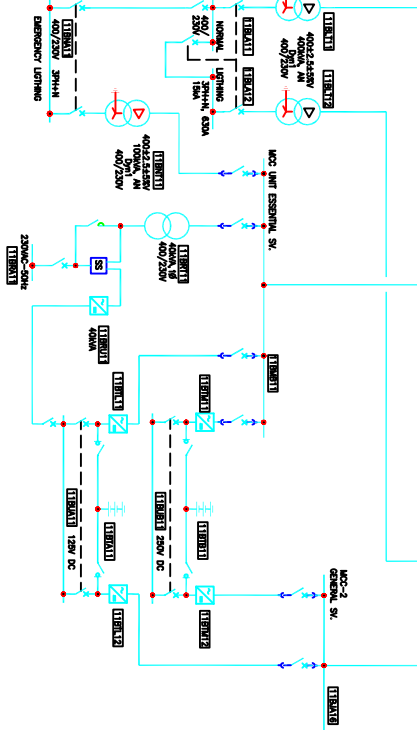


NOTES:
1- STATOR WINDING VOLTAGE LEVELS AT LOAD TERMINALS ARE AS FOLLOWS:
6.6KV/10KV
13.8KV/24KV
20KV/36KV
25KV/48KV
15KV/24KV

2- MOTOR RATED VOLTAGES VERSUS RATED POWER ARE AS FOLLOWS:
15KV/24KV
20KV/36KV
25KV/48KV
15KV/24KV
20KV/36KV
25KV/48KV

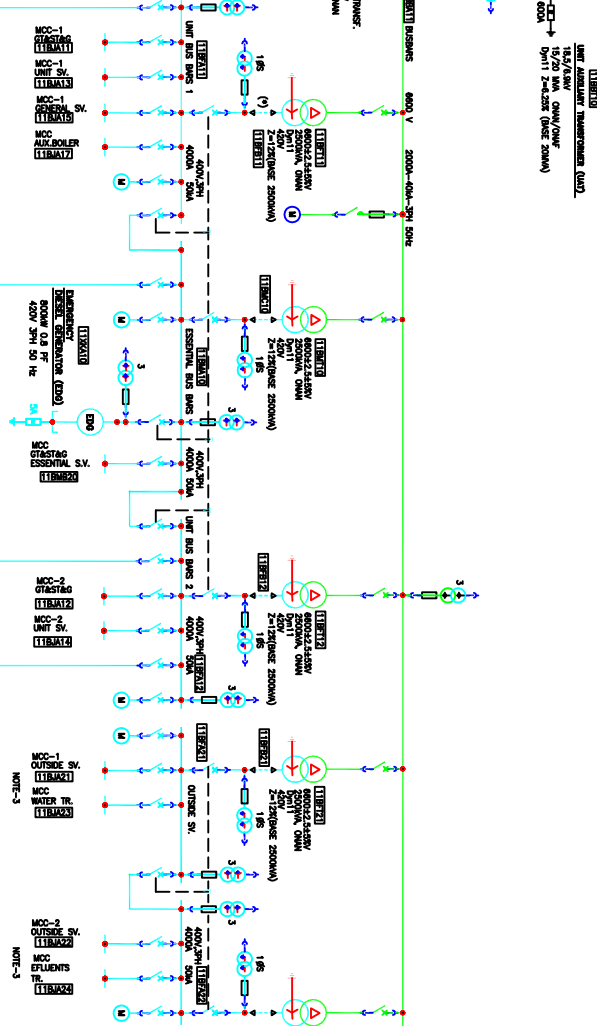

ENDESA FRANCE

G.E.-COBRA-INTEC

C.C. PP LUCY

SINGLE LINE DIAGRAM									
NO.	DATE	BY	CHKD.	APP.	REV.	DESCRIPTION	REVISION	DATE	BY
1	10/10/00	...	...	...	1	...	...	...	...
2	10/10/00	...	...	...	2	...	...	...	...
3	10/10/00	...	...	...	3	...	...	...	...
4	10/10/00	...	...	...	4	...	...	...	...
5	10/10/00	...	...	...	5	...	...	...	...
6	10/10/00	...	...	...	6	...	...	...	...